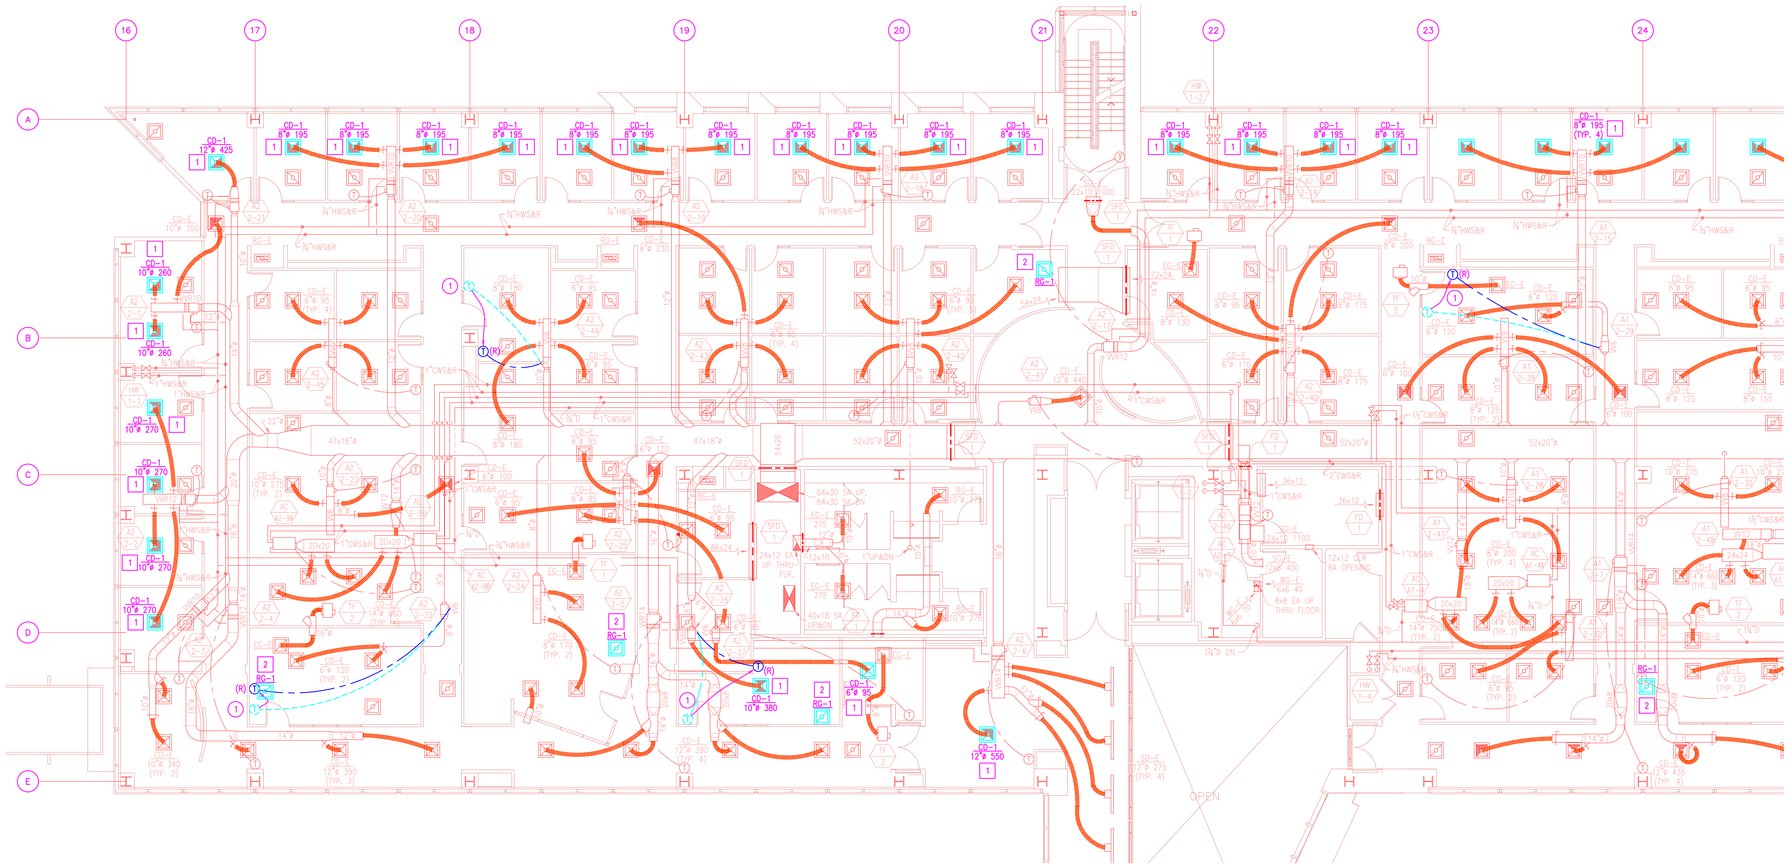

GENERAL NOTES:

1. EXISTING DUCT SIZES SHOWN ARE BASED ON PREVIOUS PROJECT DRAWINGS. DUCT DIMENSIONS ARE INTERIOR FREE AREA AND ARE EXPRESSED IN INCHES.
2. BRANCH DUCTS TO DIFFUSERS SHALL GENERALLY BE THE SAME SIZE AS DIFFUSER NECK EXCEPT WHEN INDICATED OTHERWISE.
3. DARKENED QUADRANTS OF SUPPLY DIFFUSERS INDICATE NO FLOW IN THAT DIRECTION. ONE BLANKED OFF QUADRANT INDICATES THREE WAY THROW, TWO BLANKED OFF QUADRANTS INDICATES 2 WAY THROW AND THREE BLANKED OFF QUADRANTS INDICATES 1 WAY THROW.

MECHANICAL WORK NOTES:

1. REPLACE EXISTING DIFFUSER IN SAME LOCATION AS SHOWN AND SCHEDULED.
2. NEW RETURN AIR GRILLE. MOUNT IN CEILING GRID AS CLOSE AS POSSIBLE TO DIRECTLY ABOVE TEMPERATURE CONTROLLER (THERMOSTAT).
3. REPLACE EXISTING DIFFUSER. RELOCATE TO NEW POSITION AS SHOWN.
4. RELOCATE EXISTING GRILLE OR DIFFUSER AS INDICATED. EXTEND DUCT USING FLEXIBLE DUCTWORK SUPPORTING AS NECESSARY.

CONTROL WORK NOTES:

1. RELOCATE EXISTING DDC TEMPERATURE CONTROLLER (THERMOSTAT) TO NEW LOCATION. PROVIDE COVER PLATE FOR EXISTING JUNCTION BOX.

KEY PLAN

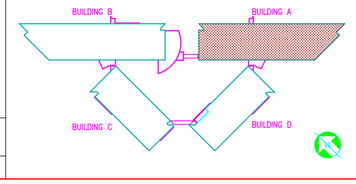

Andy's Best CAD
1323 Carlyle Park Circle
Highlands Ranch, CO 80129
303-808-3352
andysbestcad@yahoo.com
www.andysbestcad.com

ABC NO: H05 DATE: 11/30/11

ISSUE:

NO:	DATE:	ISSUE:

DRAWN: ABC
DESIGNED:
CHECKED:
CLIENT JOB NO.:
DATE: 11/30/11
FILE: ABC-H05-02-M22.dwg

DRAWING TITLE:
BUILDING A
2ND FLOOR WEST
HVAC PLAN

DRAWING NUMBER:
M2.2-AW

M2.2-AW BUILDING A 2ND FLOOR WEST HVAC PLAN
1/8"=1'-0"

COPYRIGHT ANDY'S BEST CAD, ALL RIGHTS RESERVED. THIS DRAWING IS THE PROPERTY OF ANDY'S BEST CAD AND IS PROTECTED BY COPYRIGHT LAWS OF THE UNITED STATES OF AMERICA. ANY UNAUTHORIZED USE OF THE INFORMATION CONTAINED HEREIN OR PART THEREOF IS STRICTLY PROHIBITED. RECEIPT OR POSSESSION THEREOF DOES NOT CONVEY OR TRANSFER ANY RIGHT TO MAKE, COPY MANUFACTURE AND/OR SELL EITHER THE DRAWING OR THE ITEMS SHOWN THEREIN.