


© 2022 ANDY'S BEST CAD. ALL RIGHTS RESERVED. THIS DRAWING IS THE PROPERTY OF ANDY'S BEST CAD AND IS PROTECTED BY COPYRIGHT LAWS OF THE UNITED STATES OF AMERICA. ANY UNAUTHORIZED USE OF THE INFORMATION CONTAINED HEREIN OR PART THEREOF IS STRICTLY PROHIBITED. RECEIPT OR POSSESSION THEREOF DOES NOT CONVEY OR TRANSFER ANY RIGHT TO MAKE, COPY, MANUFACTURE AND/OR RESELL EITHER THE DRAWING OR THE ITEMS SHOWN THEREIN.

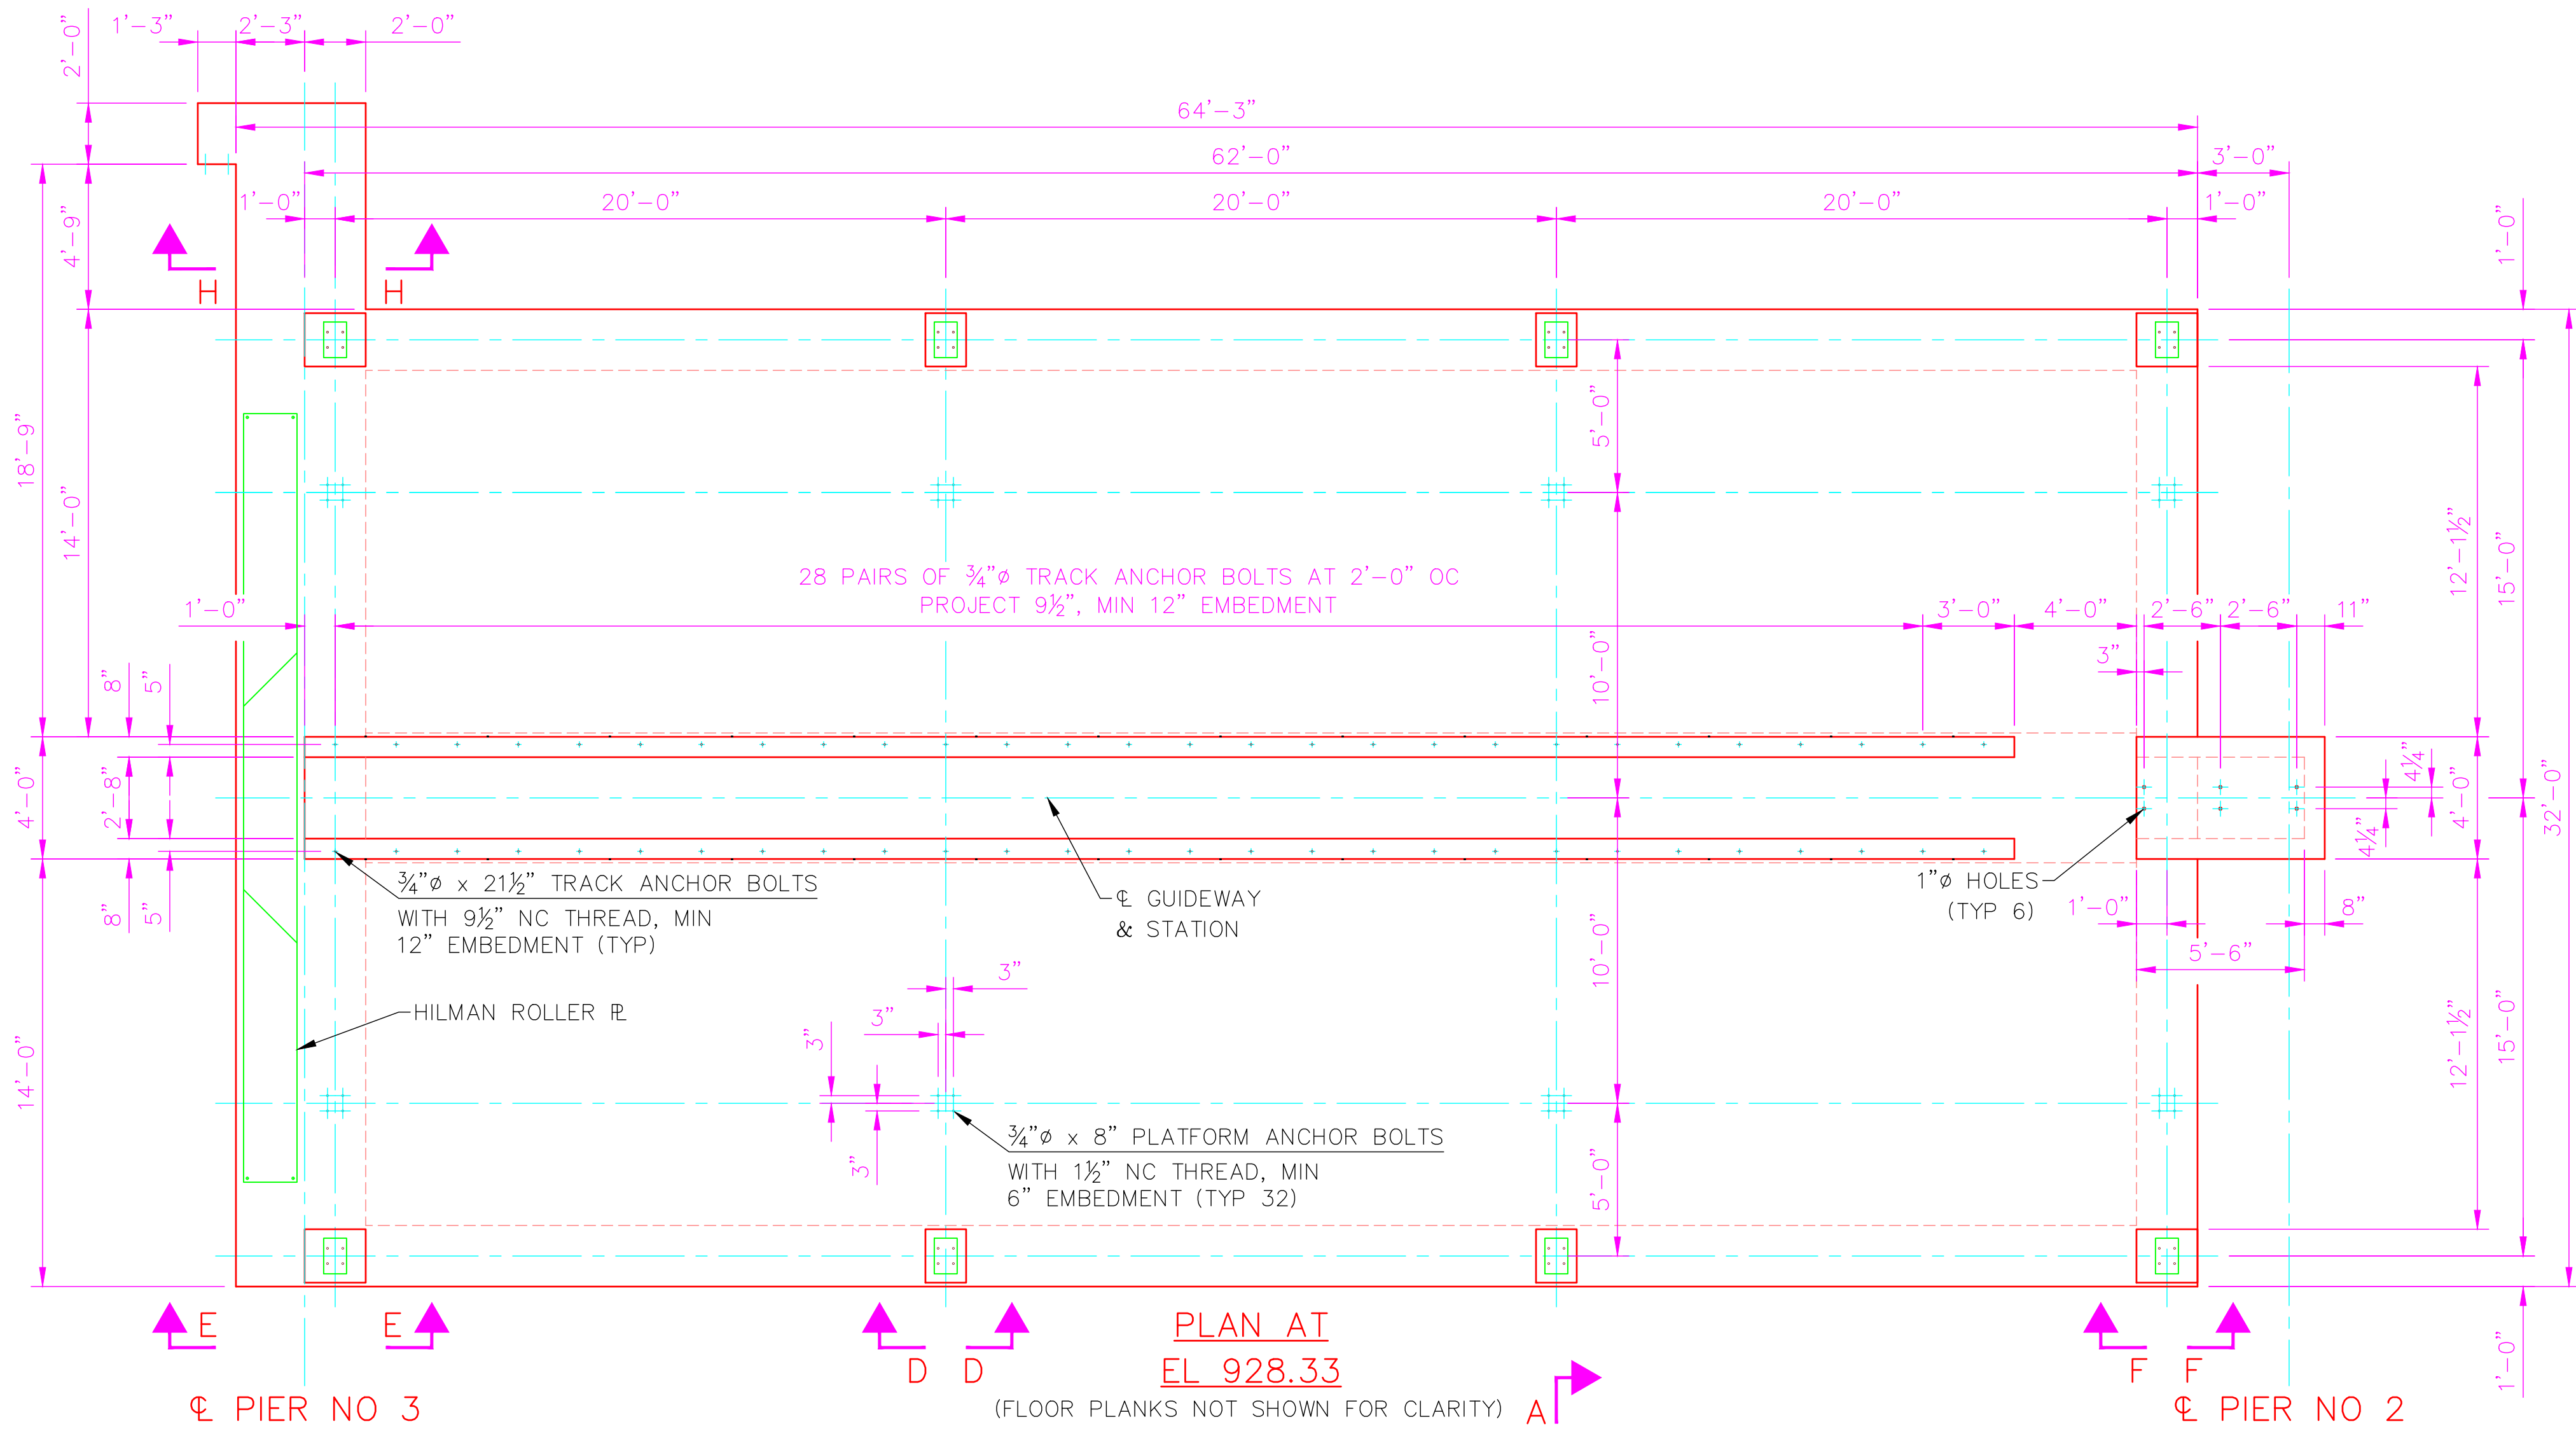

NOTES

CONCRETE
CLASSES: 28-DAY CYLINDER STRENGTH (PSI) MAXIMUM AGGREGATE SIZE (IN)
CAST-IN-PLACE COLUMNS 4,000 1 1/2
DRILLED SHAFT FOUNDATIONS 4,000 1 1/2
PRECAST PIER CAPITALS 6,000 3/4
STATION SLAB 4,000 1 1/2

REINFORCEMENT
GRADE: AASHTO M31/ASTM A615 GRADE 60, DEFORMED BARS



COVER:
CAST-IN-PLACE COLUMNS: 2 IN UNLESS NOTED OTHERWISE
DRILLED SHAFT FOUNDATIONS: 3 IN UNLESS NOTED OTHERWISE
PRECAST PIER CAPITALS: 1 1/4 IN UNLESS NOTED OTHERWISE
STATION SLAB-TOP: 2 IN UNLESS NOTED OTHERWISE
STATION SLAB-UNDERSIDE: 3 IN UNLESS NOTED OTHERWISE

DIMENSIONING
ALL DIMENSIONS ARE GIVEN IN FEET AND INCHES UNLESS NOTED OTHERWISE
REINFORCING BAR DESIGNATION

NUMBER OF BARS 88-1001-12 BAR SPACING
BAR SIZE DESIGNATION MARK

GENERAL NOTES

- SEE DRAWING RC102 FOR SECTIONS B-B, C-C, D-D, E-E, F-F, G-G AND H-H
- FIRE EXTINGUISHERS TO BE LOCATED WITHIN THIS TEMPORARY STRUCTURE IN ACCORDANCE WITH THE INSTRUCTIONS OF THE FIRE MARSHALL

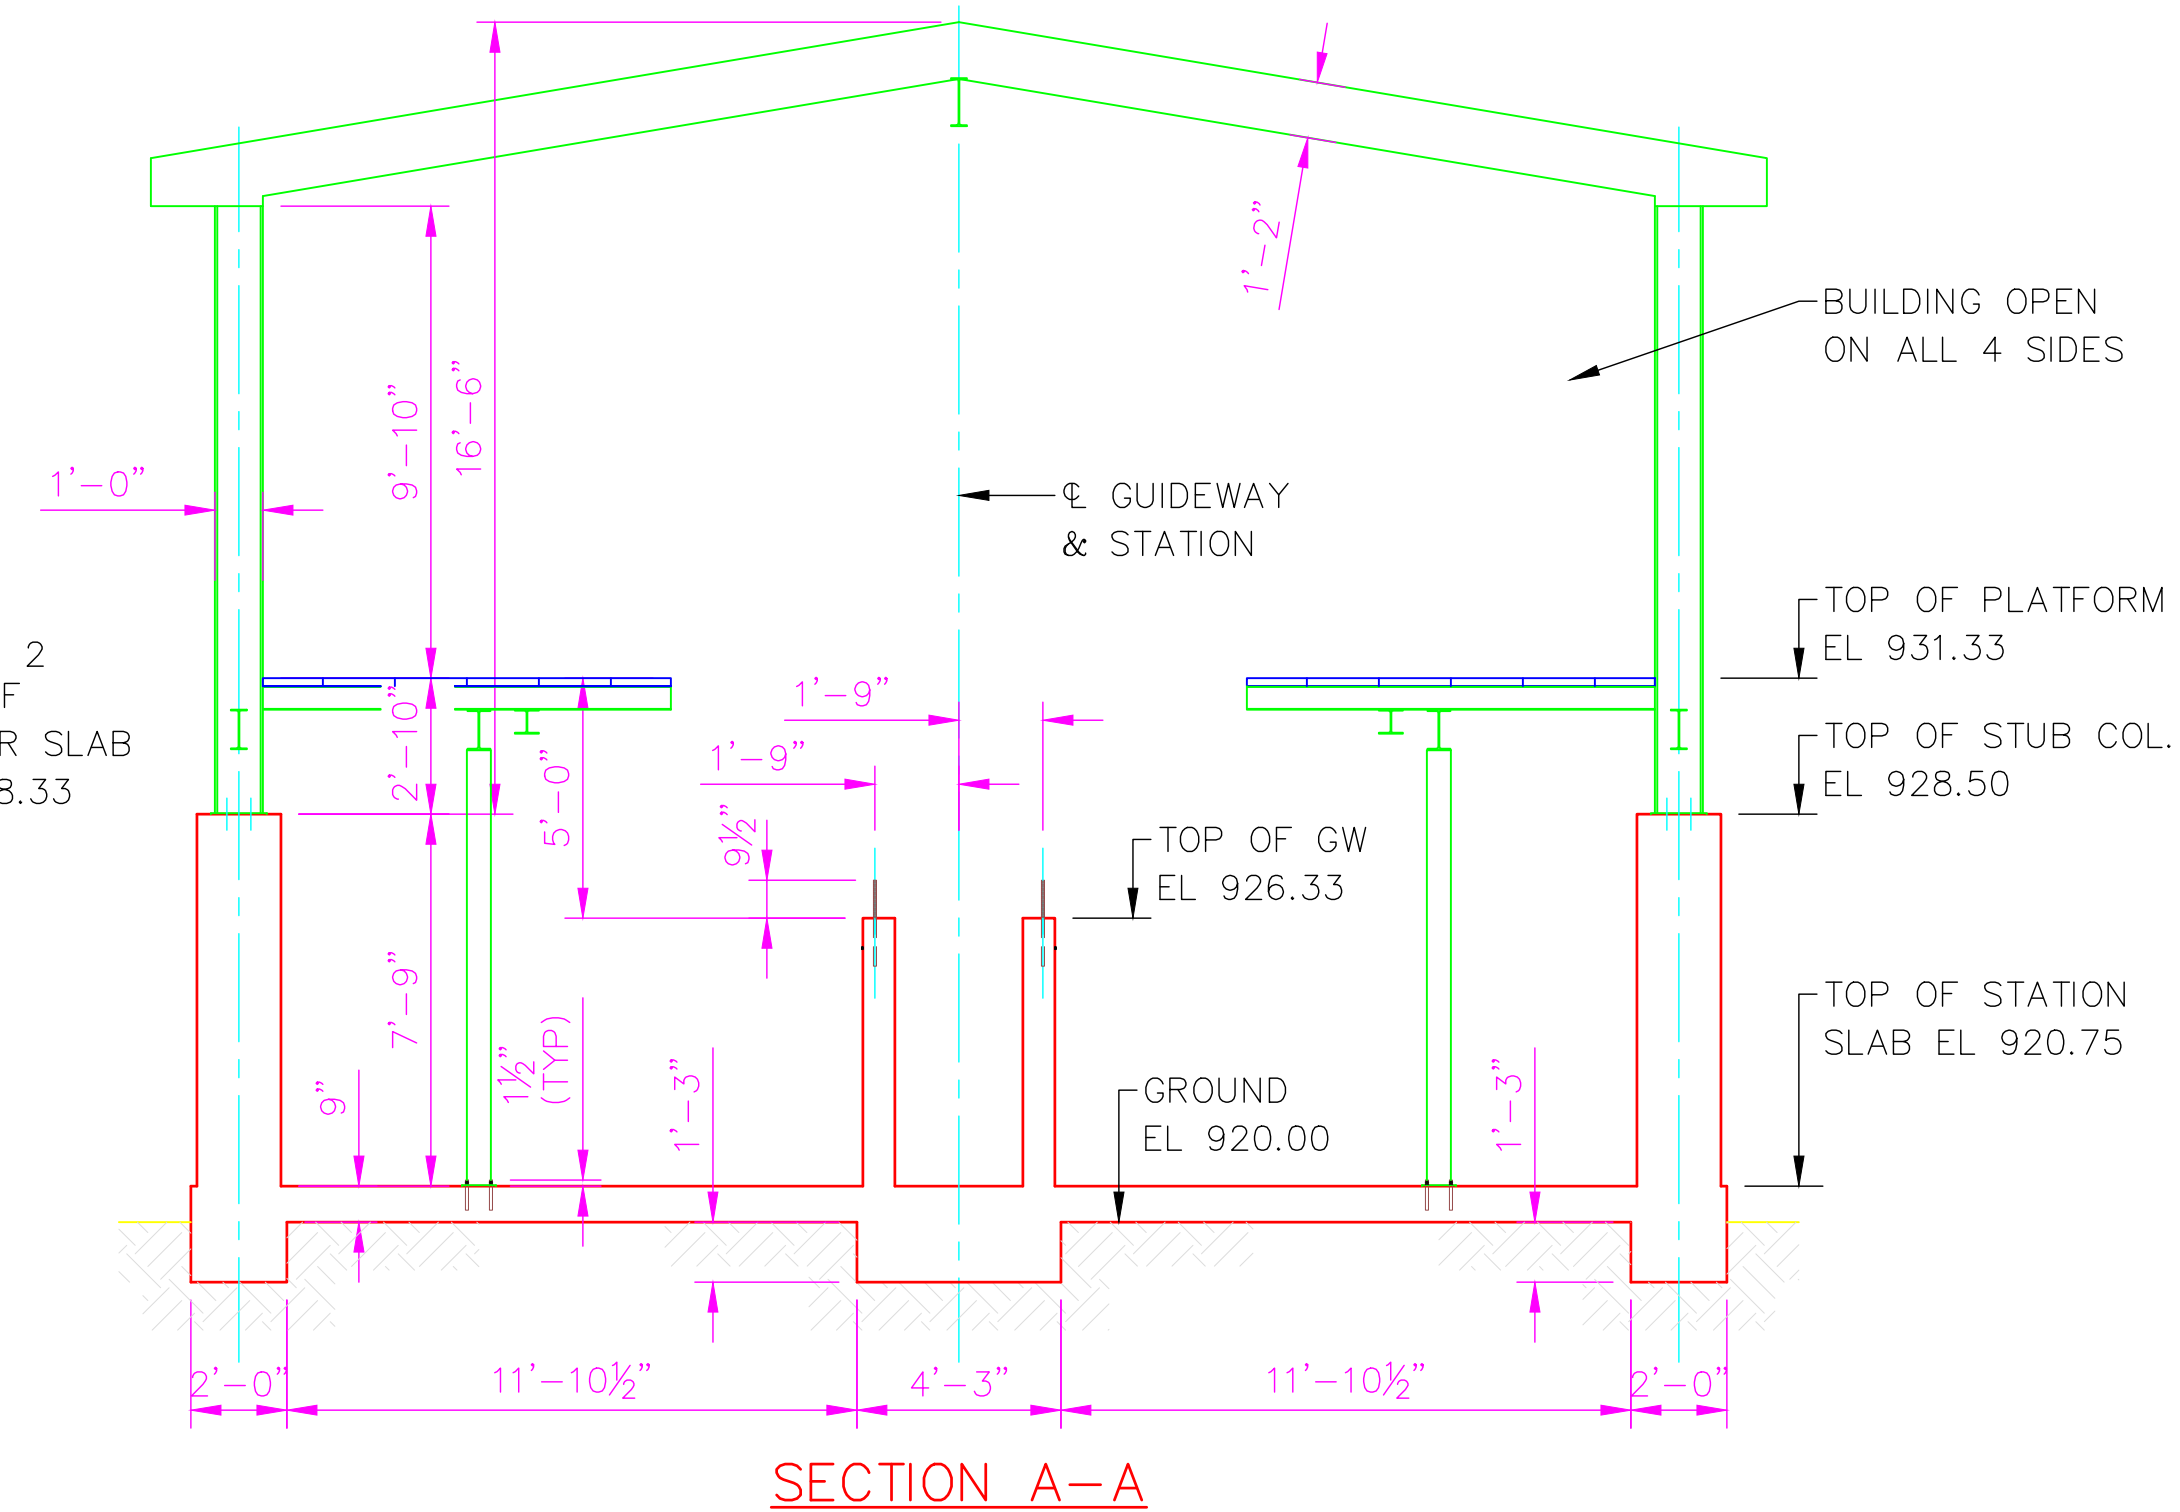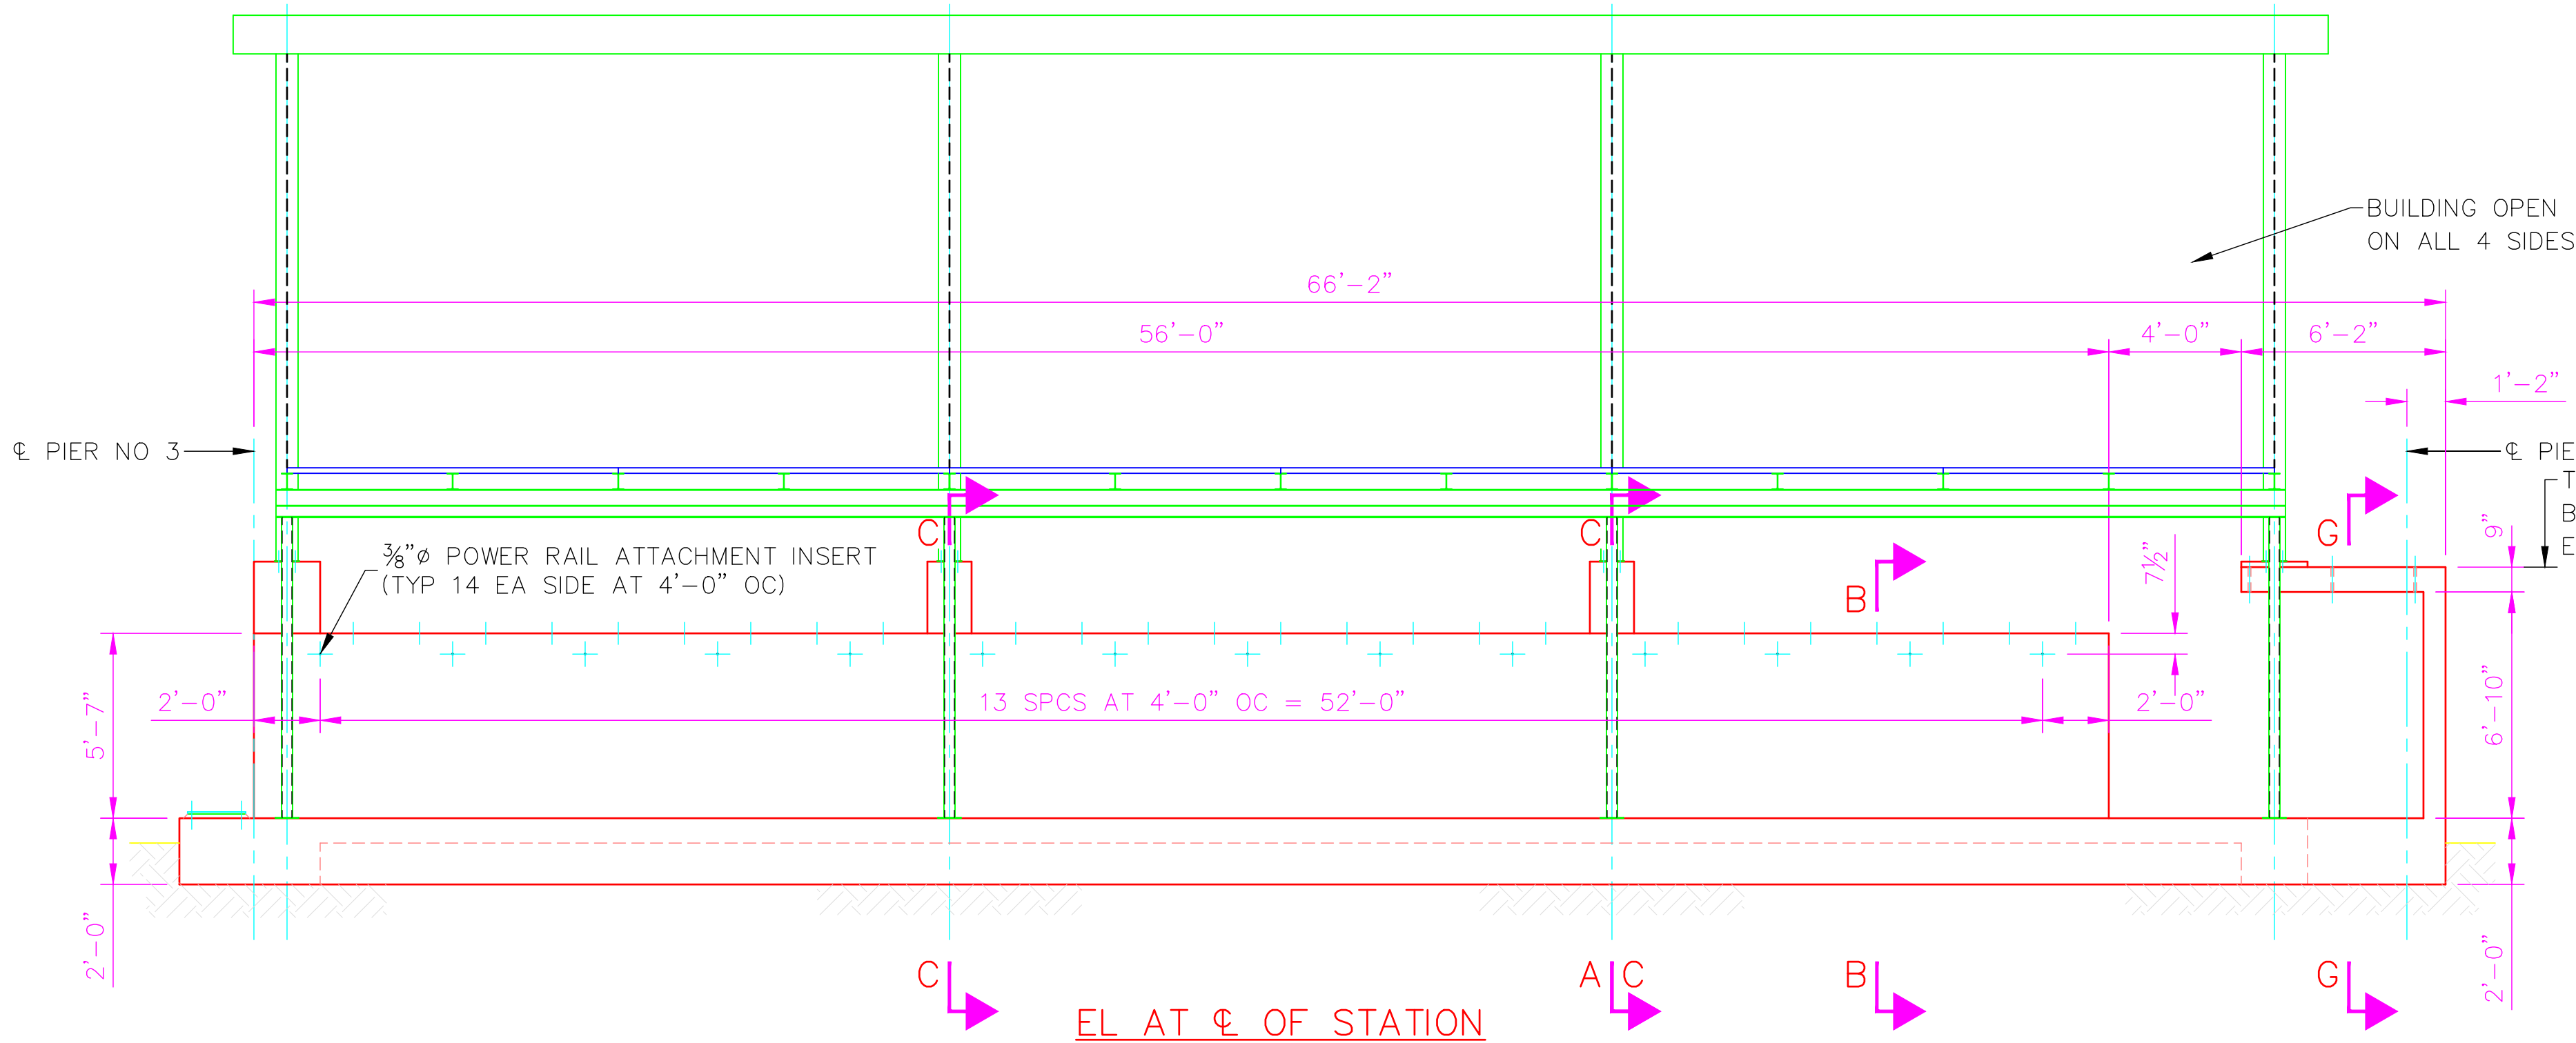

DATE:					
REV	REVISION DESCRIPTION:				
ABC	ANDY'S BEST CAD 1323 CARLYLE PARK CIRCLE HIGHLANDS RANCH, CO 80129 303-808-3352 WWW.ANDYSBESTCAD.COM				
DRAWN: ABC	DESIGNED: ABC	CLIENT: 03/14/22	AS SHOWN		
PROJECT:	STATION SUPERSTRUCTURE REINFORCED CONCRETE ENGINEERING DRAWINGS				
DRAWING TITLE:	STATION GENERAL ARRANGEMENT				
DRAWING NO:	RC101				
	OF				