




**PLAN AT WALKWAY
SUPPORT EL.
END OF WALKWAY AT PIER**

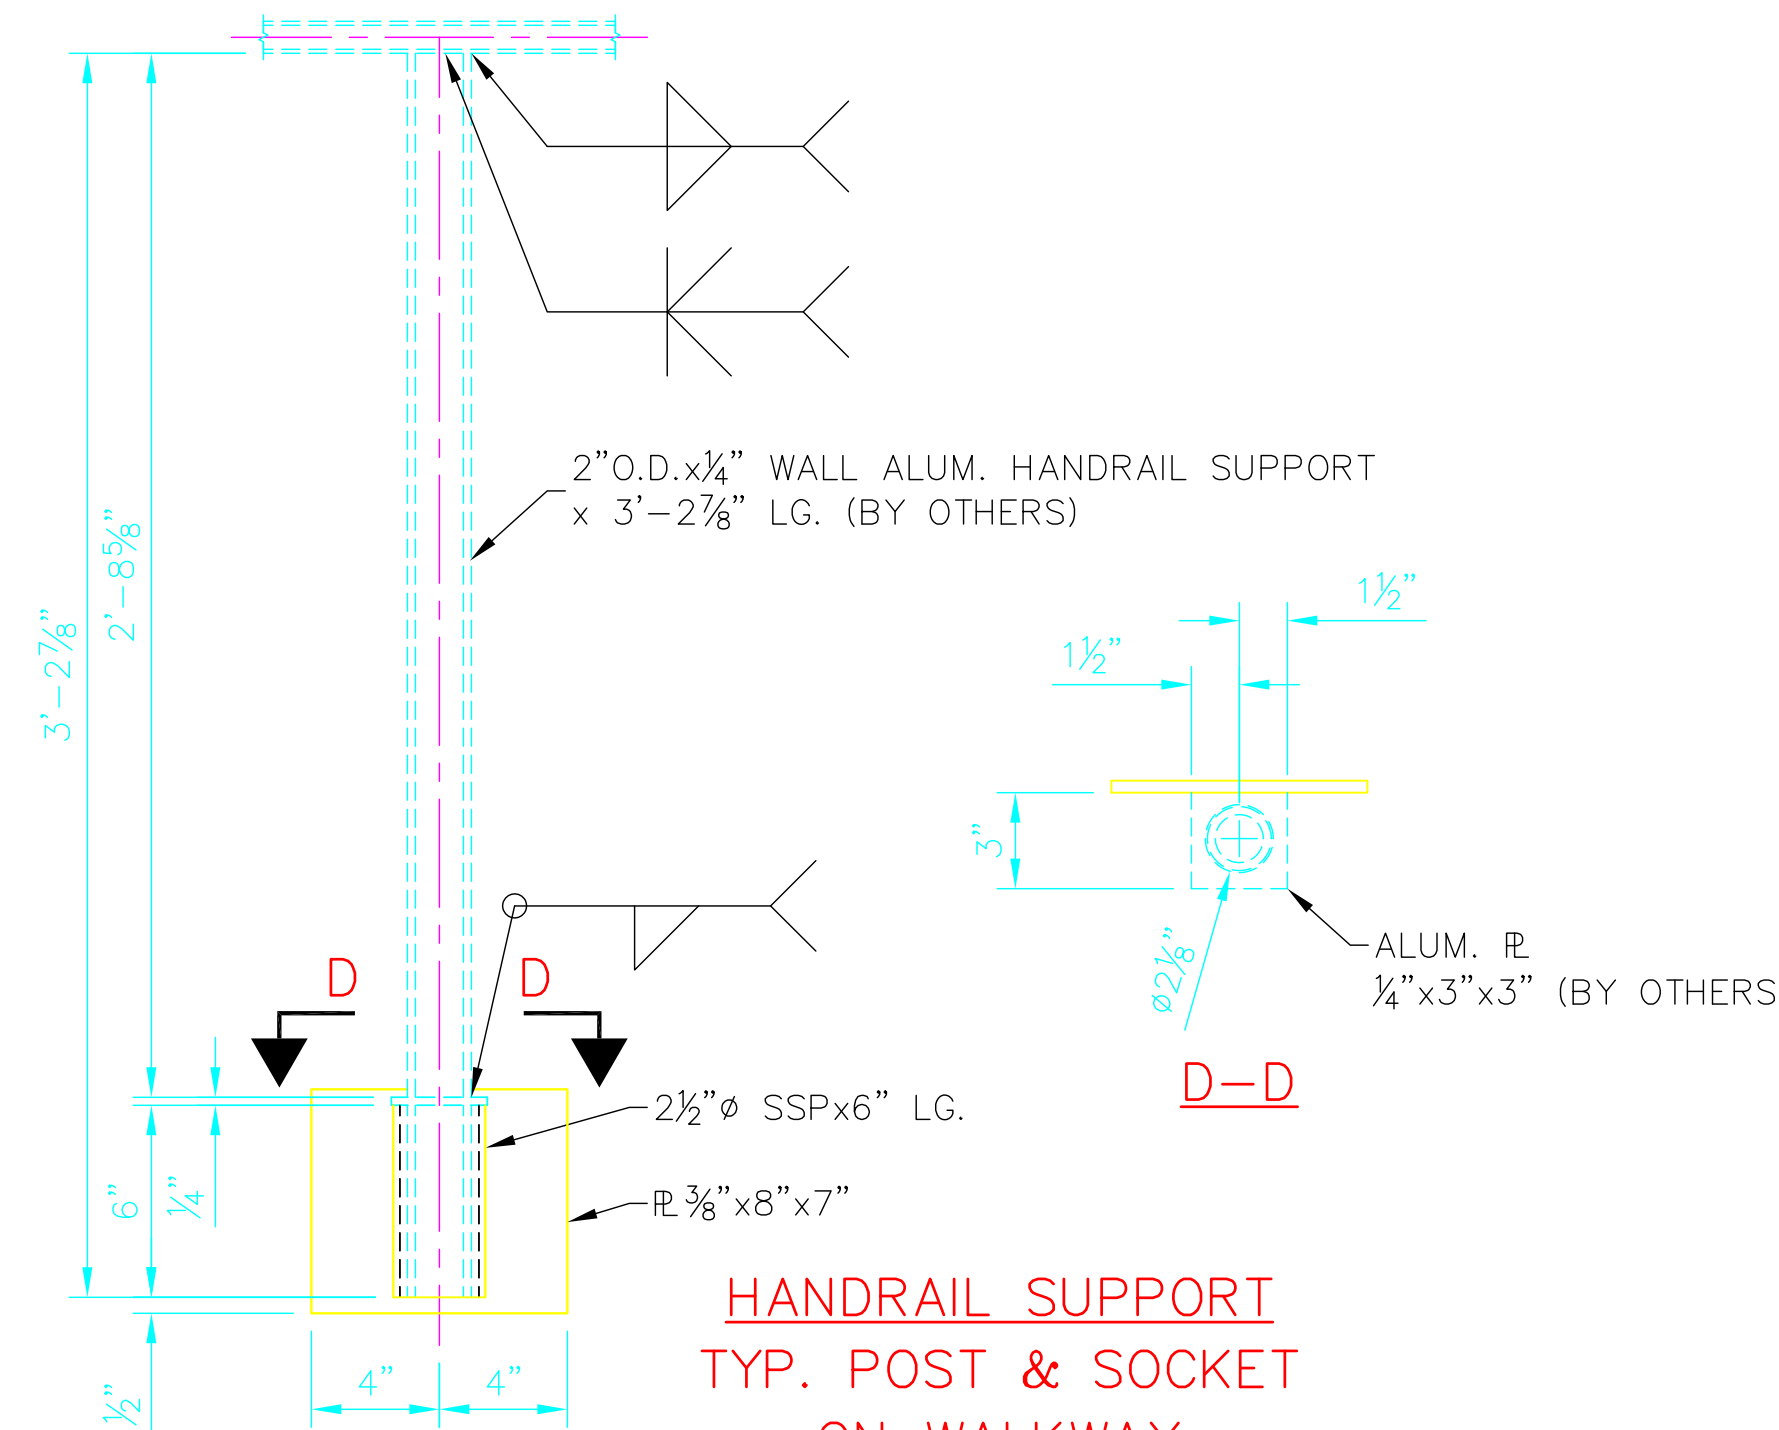


**HANDRAIL SUPPORT
TYP. POST & SOCKET
ON WALKWAY**

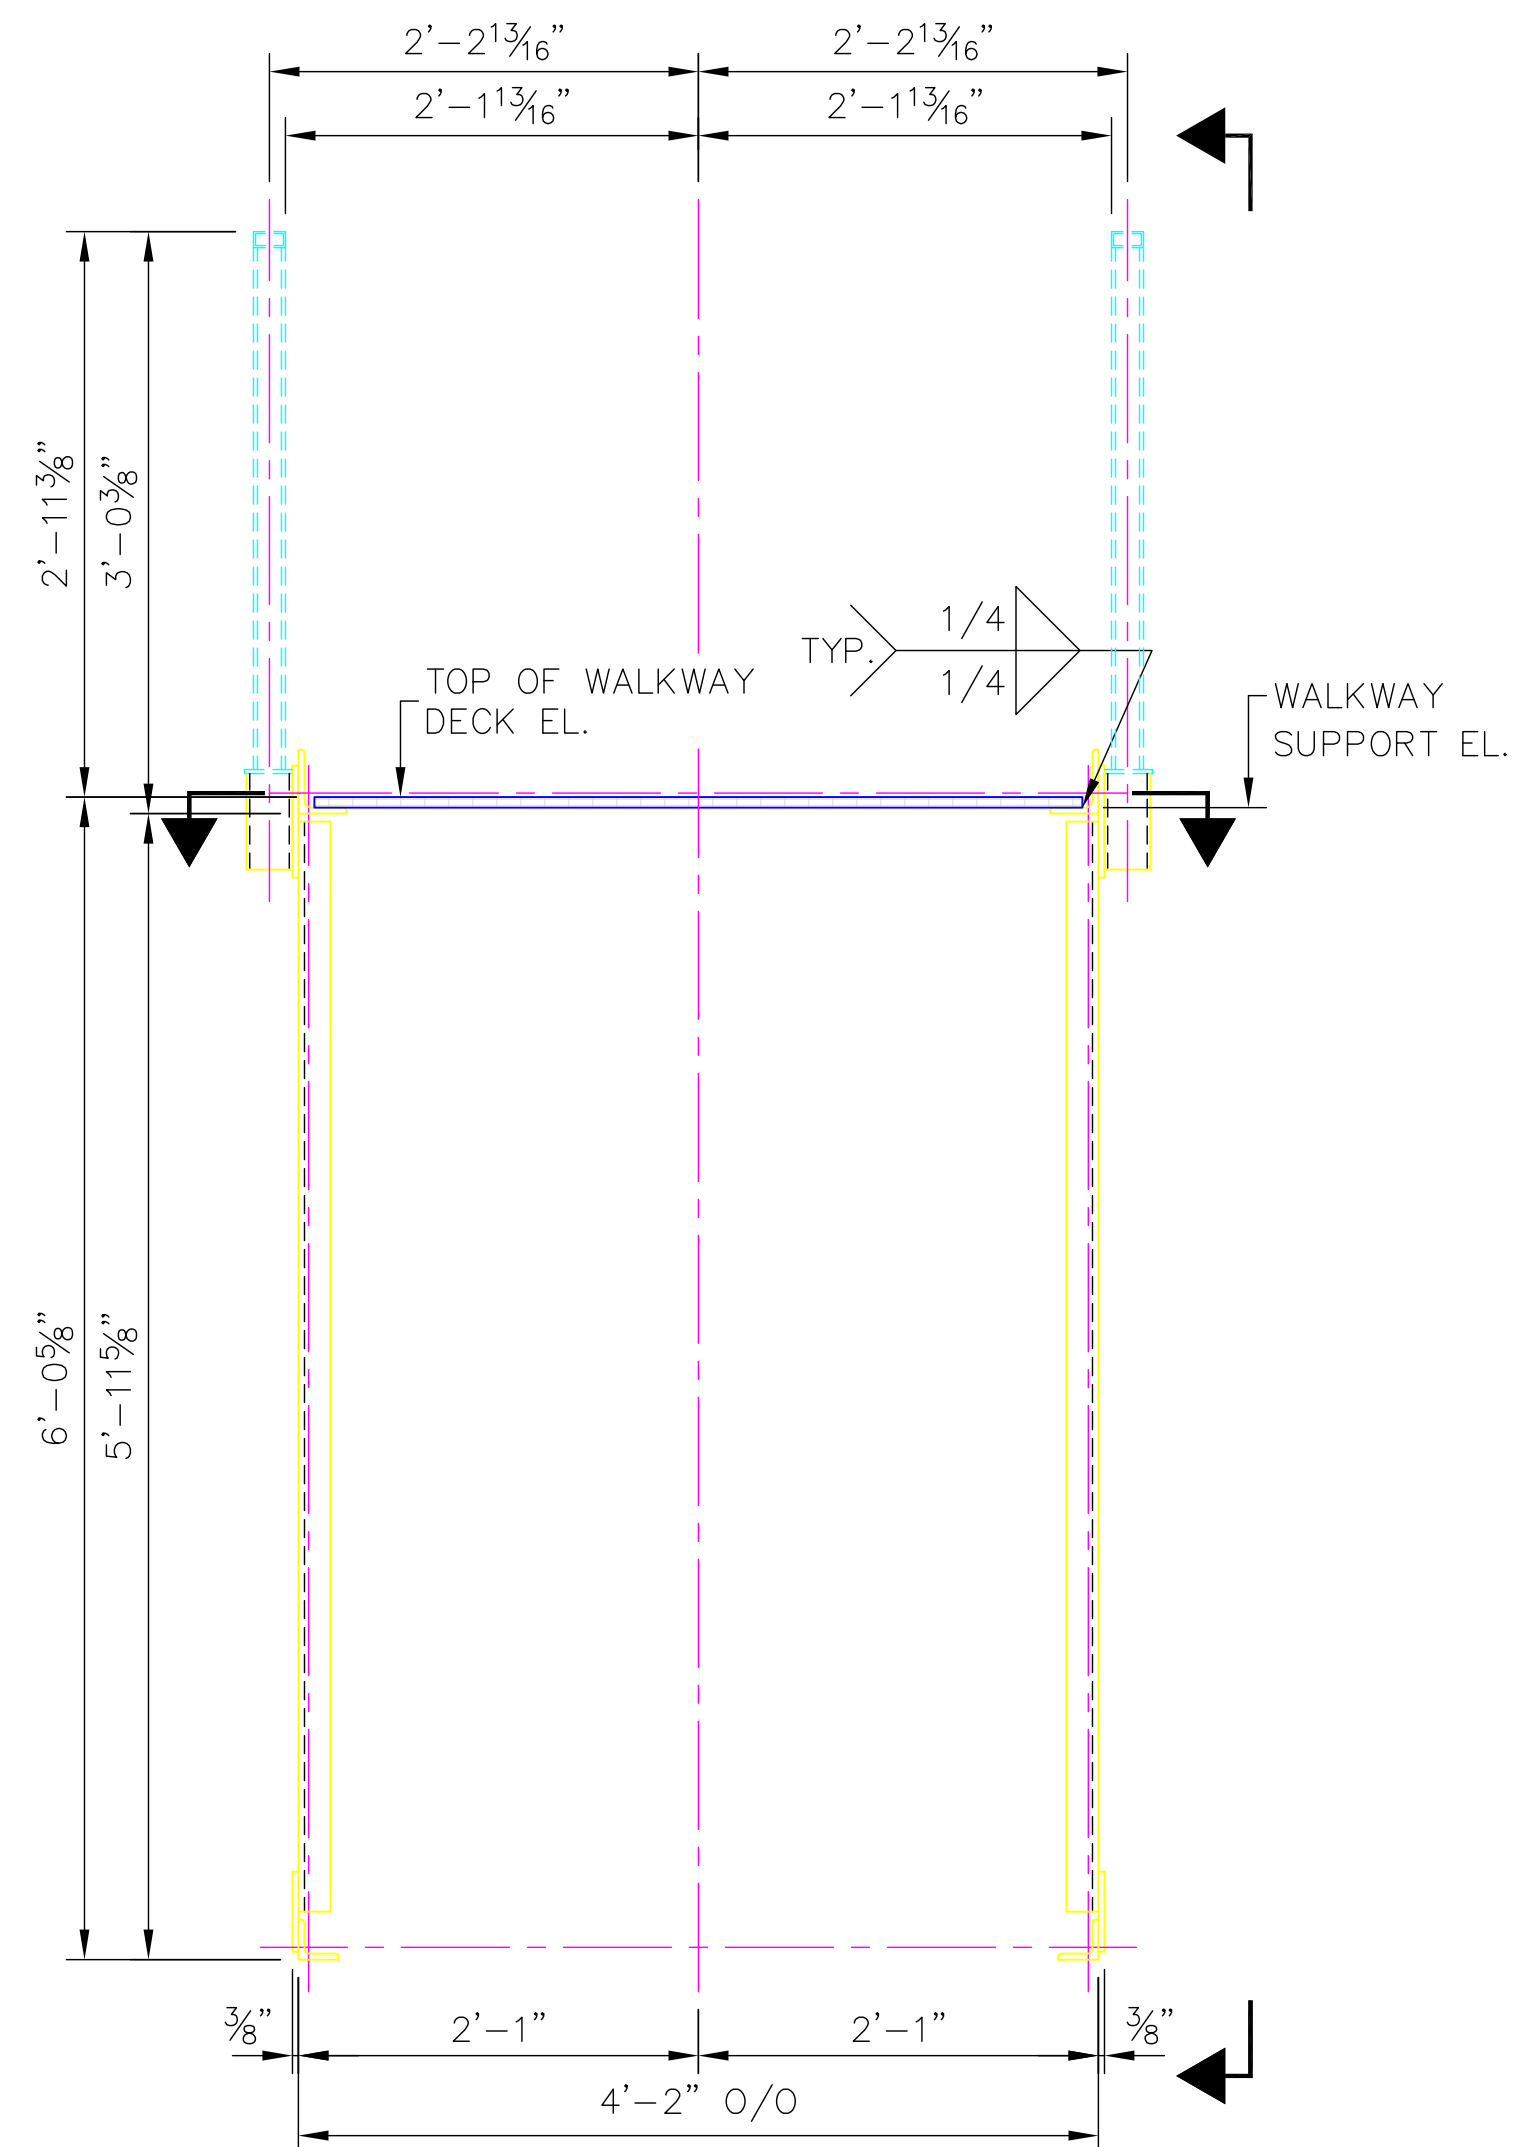

**VIEW B-B
TYP. SECTION**

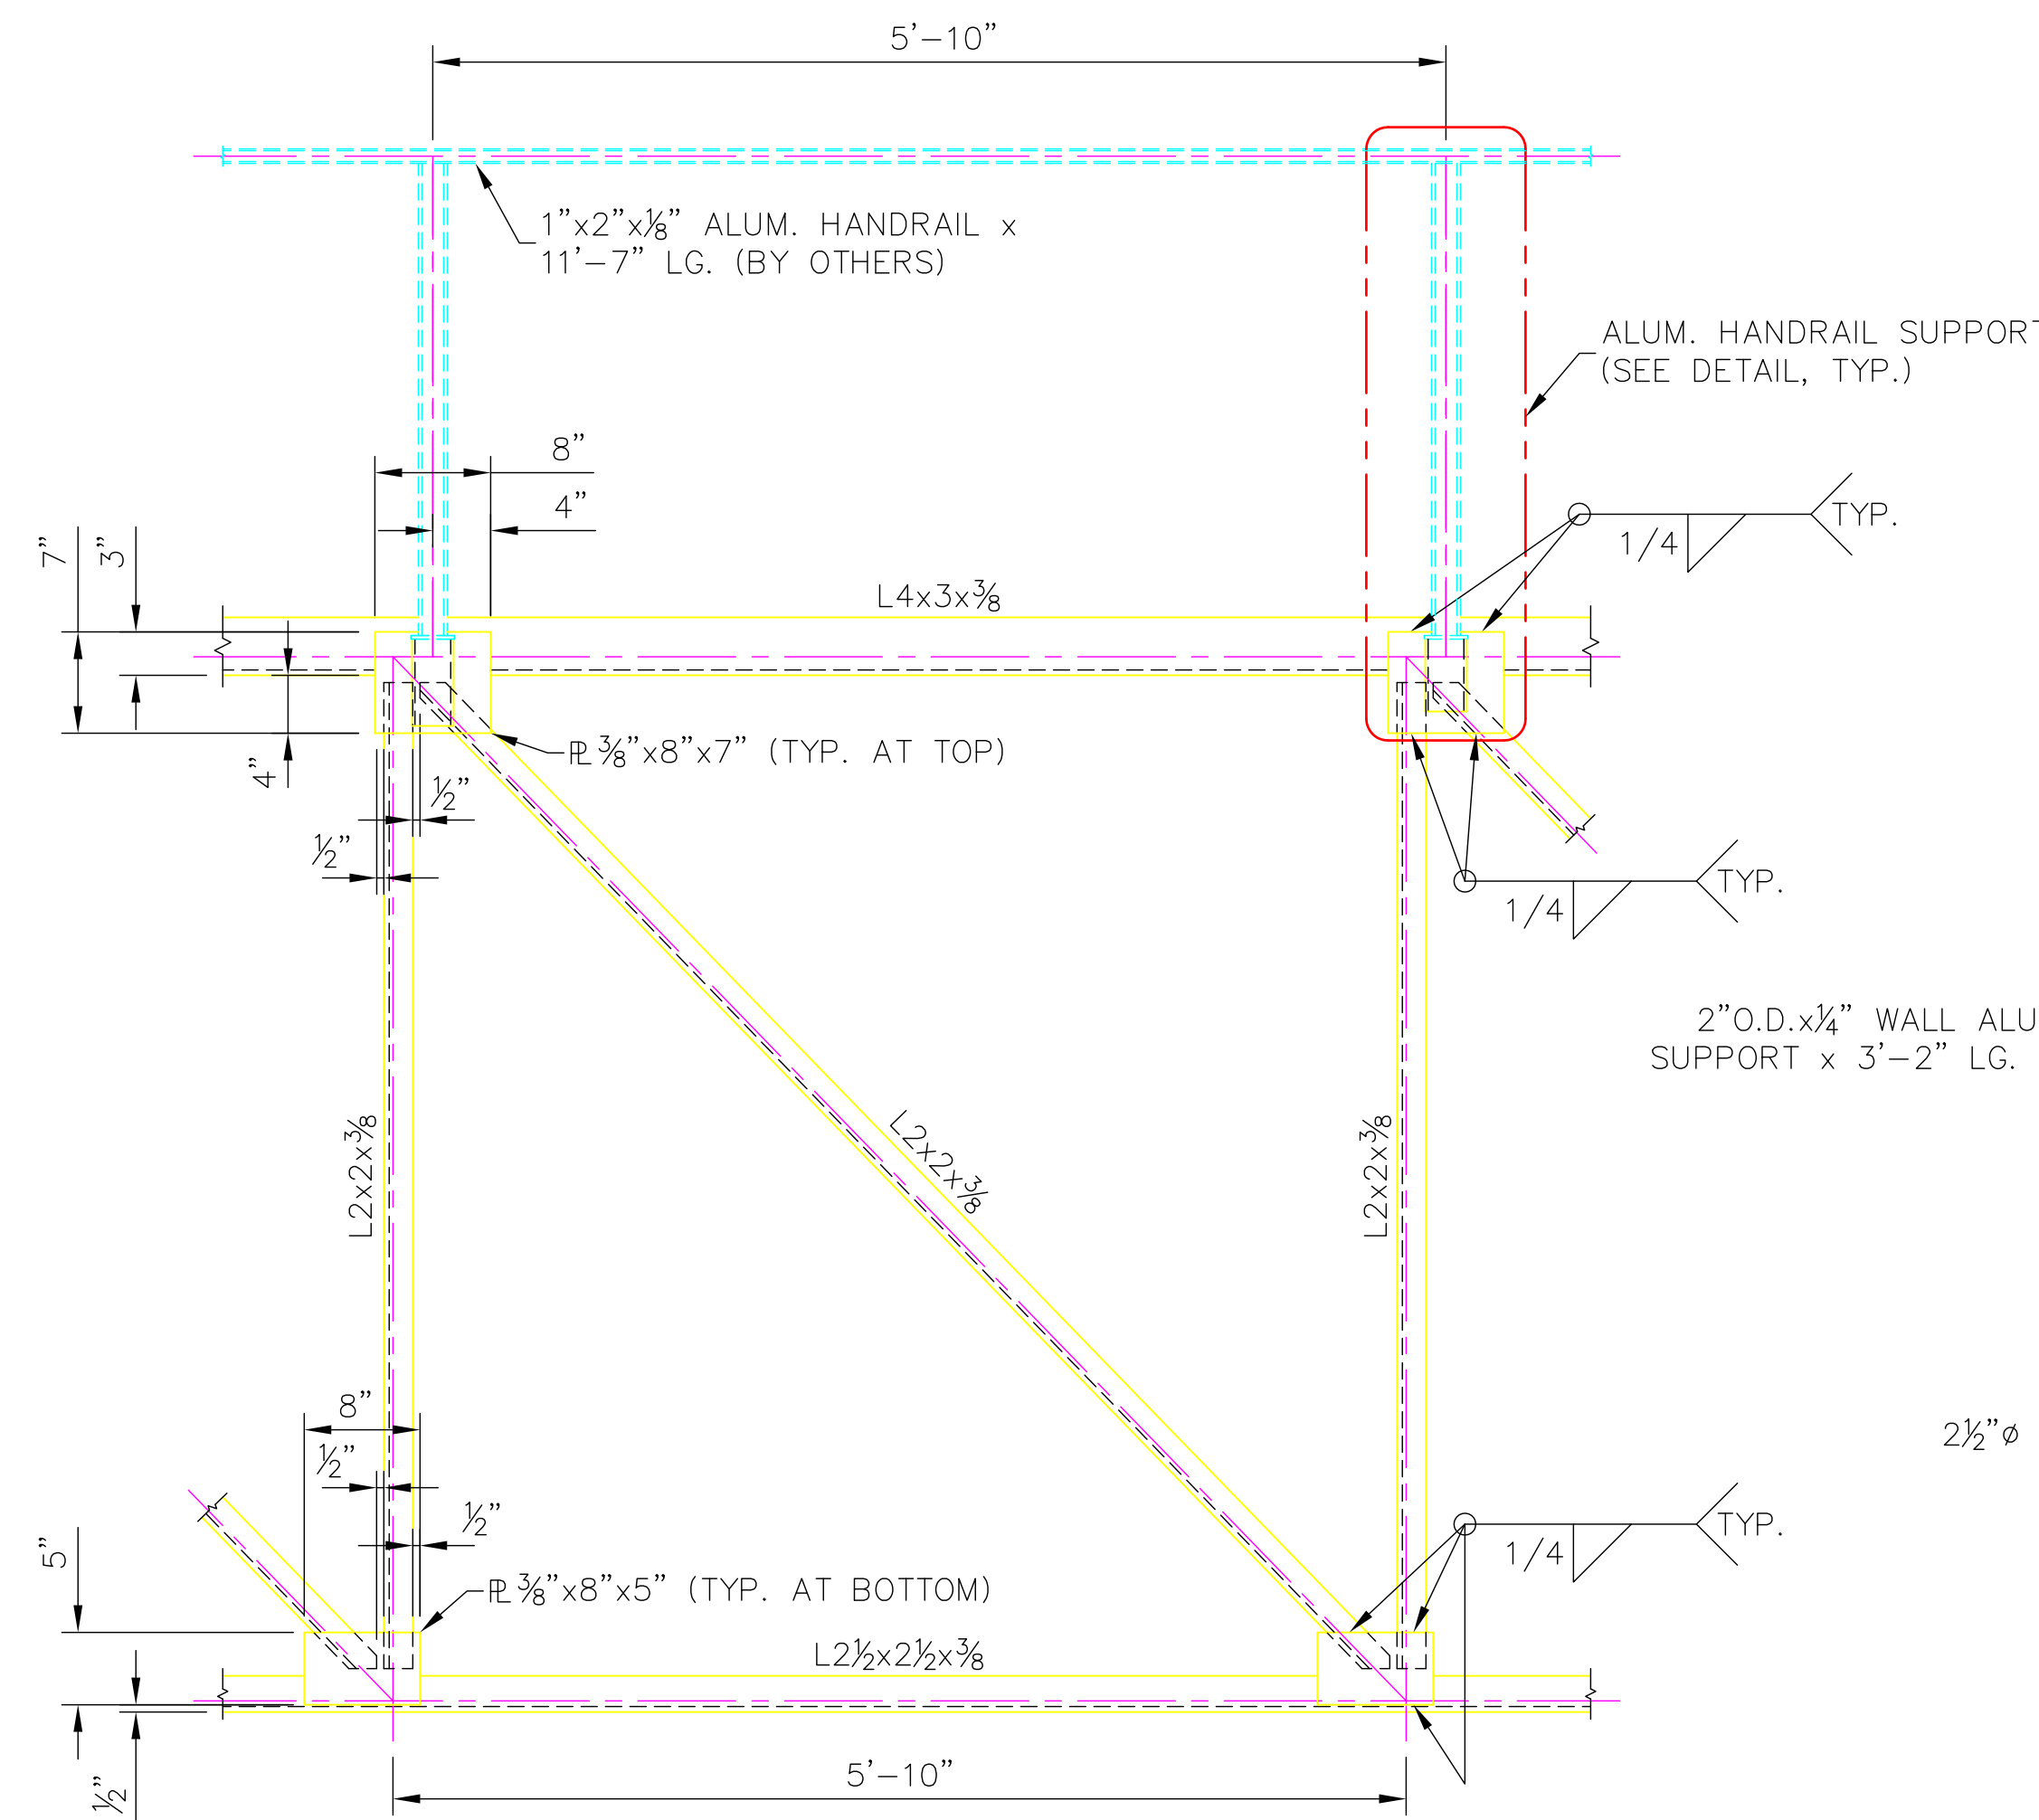

**DETAIL B
TYP. PANEL**

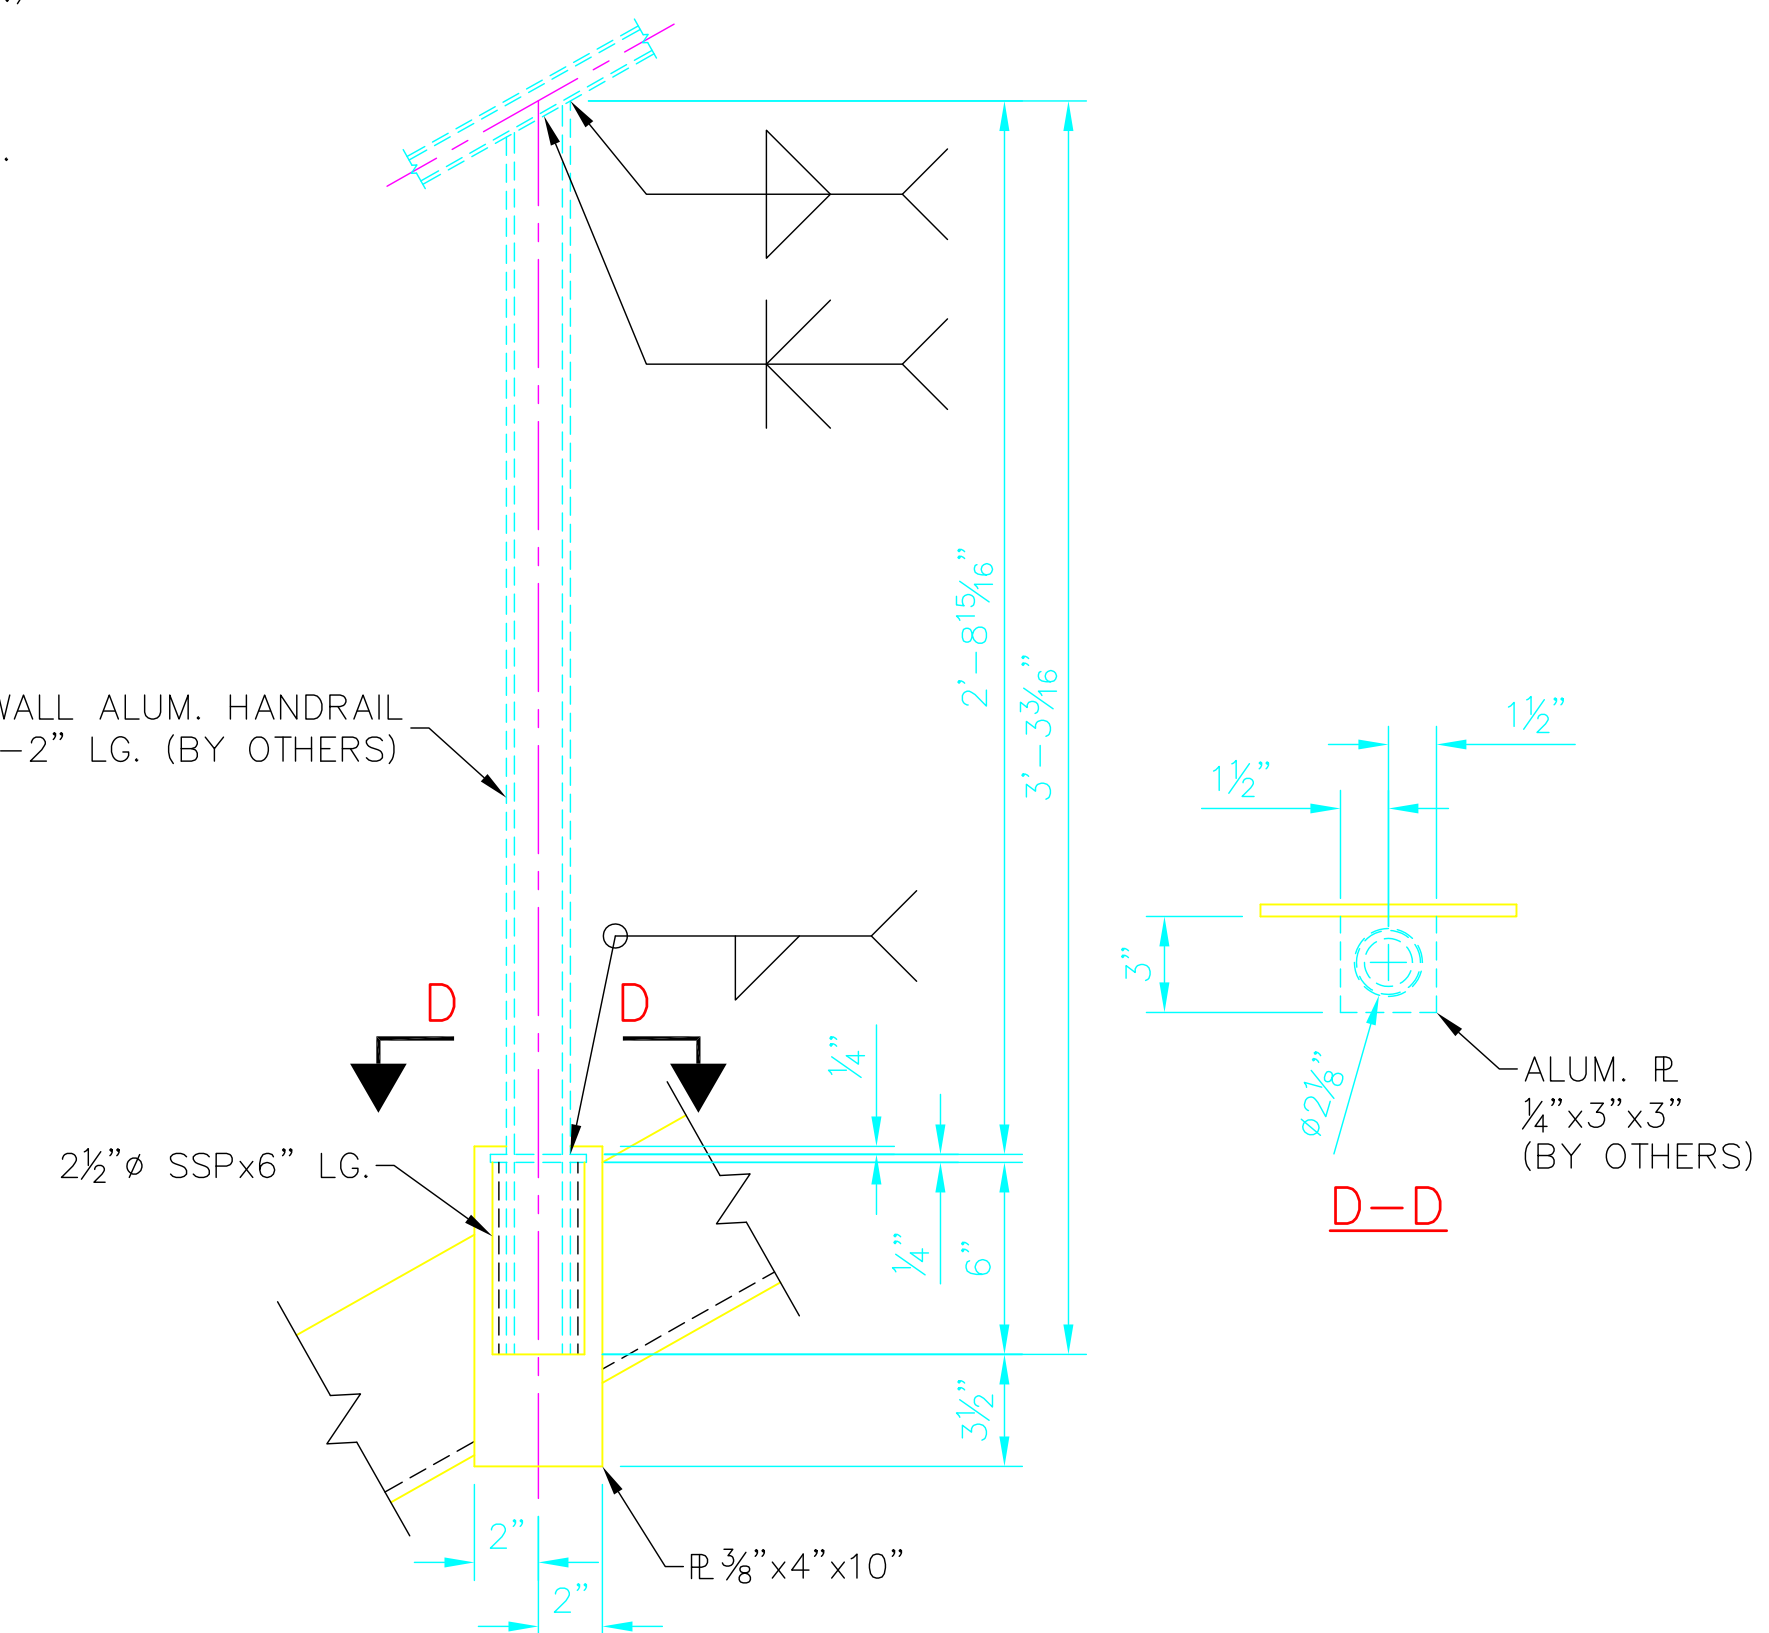

**HANDRAIL SUPPORT
TYP. POST & SOCKET ON
STAIRS (ON S04/170)**

NOTES:

1. ALL ROLLED STEEL SECTIONS SHALL COMPLY WITH THE REQUIREMENTS OF ASTM SPECIFICATION A529, GRADE 50 HAVING A MINIMUM YIELD STRENGTH OF NOT LESS THAN 50,000 LB./SQ. IN.
2. ALL NUTS, BOLTS AND WASHERS SHALL COMPLY WITH THE REQUIREMENTS OF ASTM SPECIFICATION A325.
3. ALL WELDING SHALL COMPLY WITH THE REQUIREMENTS OF AWS SPECIFICATION D1.1, USING ELECTRODES COMPLYING WITH THE REQUIREMENTS OF AWS SPECIFICATION A5.1, GRADE 48 OR BETTER.
4. OPEN MESH FLOORING SHALL COMPLY WITH THE FOLLOWING SPECIFICATION OR AN EQUIVALENT APPROVED BY THE ENGINEER:


STANDARD 5 LB./SQ. FT. 96 IN. LWD X 48 IN. SWD GALVANIZED EXPANDED METAL, BOND SHEARED LWD AND SWD; MAXIMUM DEFLECTION UNDER 100 LB./SQ. FT. UNIFORM LOADING TO BE NOT MORE THAN 1/4 IN.

ABC NO: JOB NO. DATE: DATE

Andy's Best CAD

9715 South Merimbula Street
Littleton, Colorado 80130

303-791-1622
andysbestcad@yahoo.com
www.andysbestcad.com

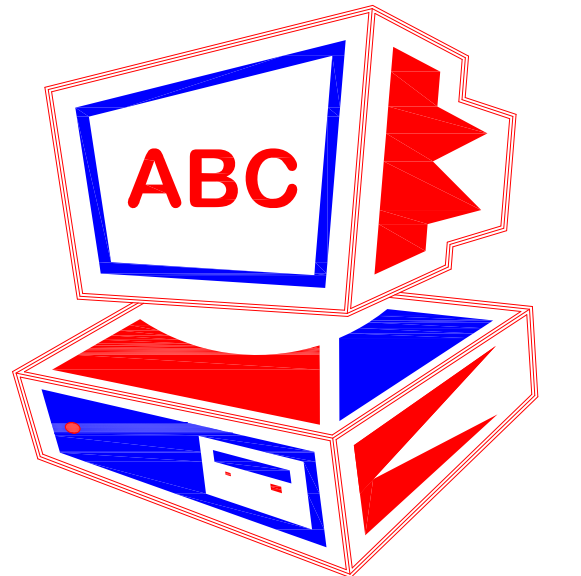

ISSUE:

NO: DATE: ISSUE:

NO:	DATE:	ISSUE:

DRAWN: A.LANDT
DESIGNED:
CHECKED:
CLIENT JOB NO.:
DATE: 05/08/07
FILE: ABC-S04-168

DRAWING TITLE:

**EMERGENCY
WALKWAY DETAILS
SHEET 2**

DRAWING NUMBER:

S04/168