


## ♦ T.O. SHEATHING VARIES



## **ROOF FRAMING SCHEDULE**

MARK	DESCRIPTION	SPACING	B.O. TRUSS ELEVATION	REMARK
1	PREFABRICATED MONO TRUSS	24" O.C.	112'-0"	NOTES 1
2	PREFABRICATED MONO TRUSS	24" O.C.	110'-0"	NOTES 1
3	117⁄8" TJI 210	24" O.C		

## NOTES:


1. PREFABRICATED TRUSSES SHALL BE DESIGNED FOR THE INDICATED DESIGN LOADS AND SPANS AND STAMPED BY A PROFESSIONAL ENGINEER REGISTERED IN THE STATE OF COLORADO.

2. TRUSS DESIGN LOADS:

30 PSF
10 PSF
10 PSF

3. ALL TRUSS BRIDGING SHALL BE DESIGNED AND PROVIDED BY TRUSS MANUFACTURER.

4. T.O. VERTICAL MEMBER FOR PREFABRICATED TRUSSES SHALL BE ELVATION 121'-0".

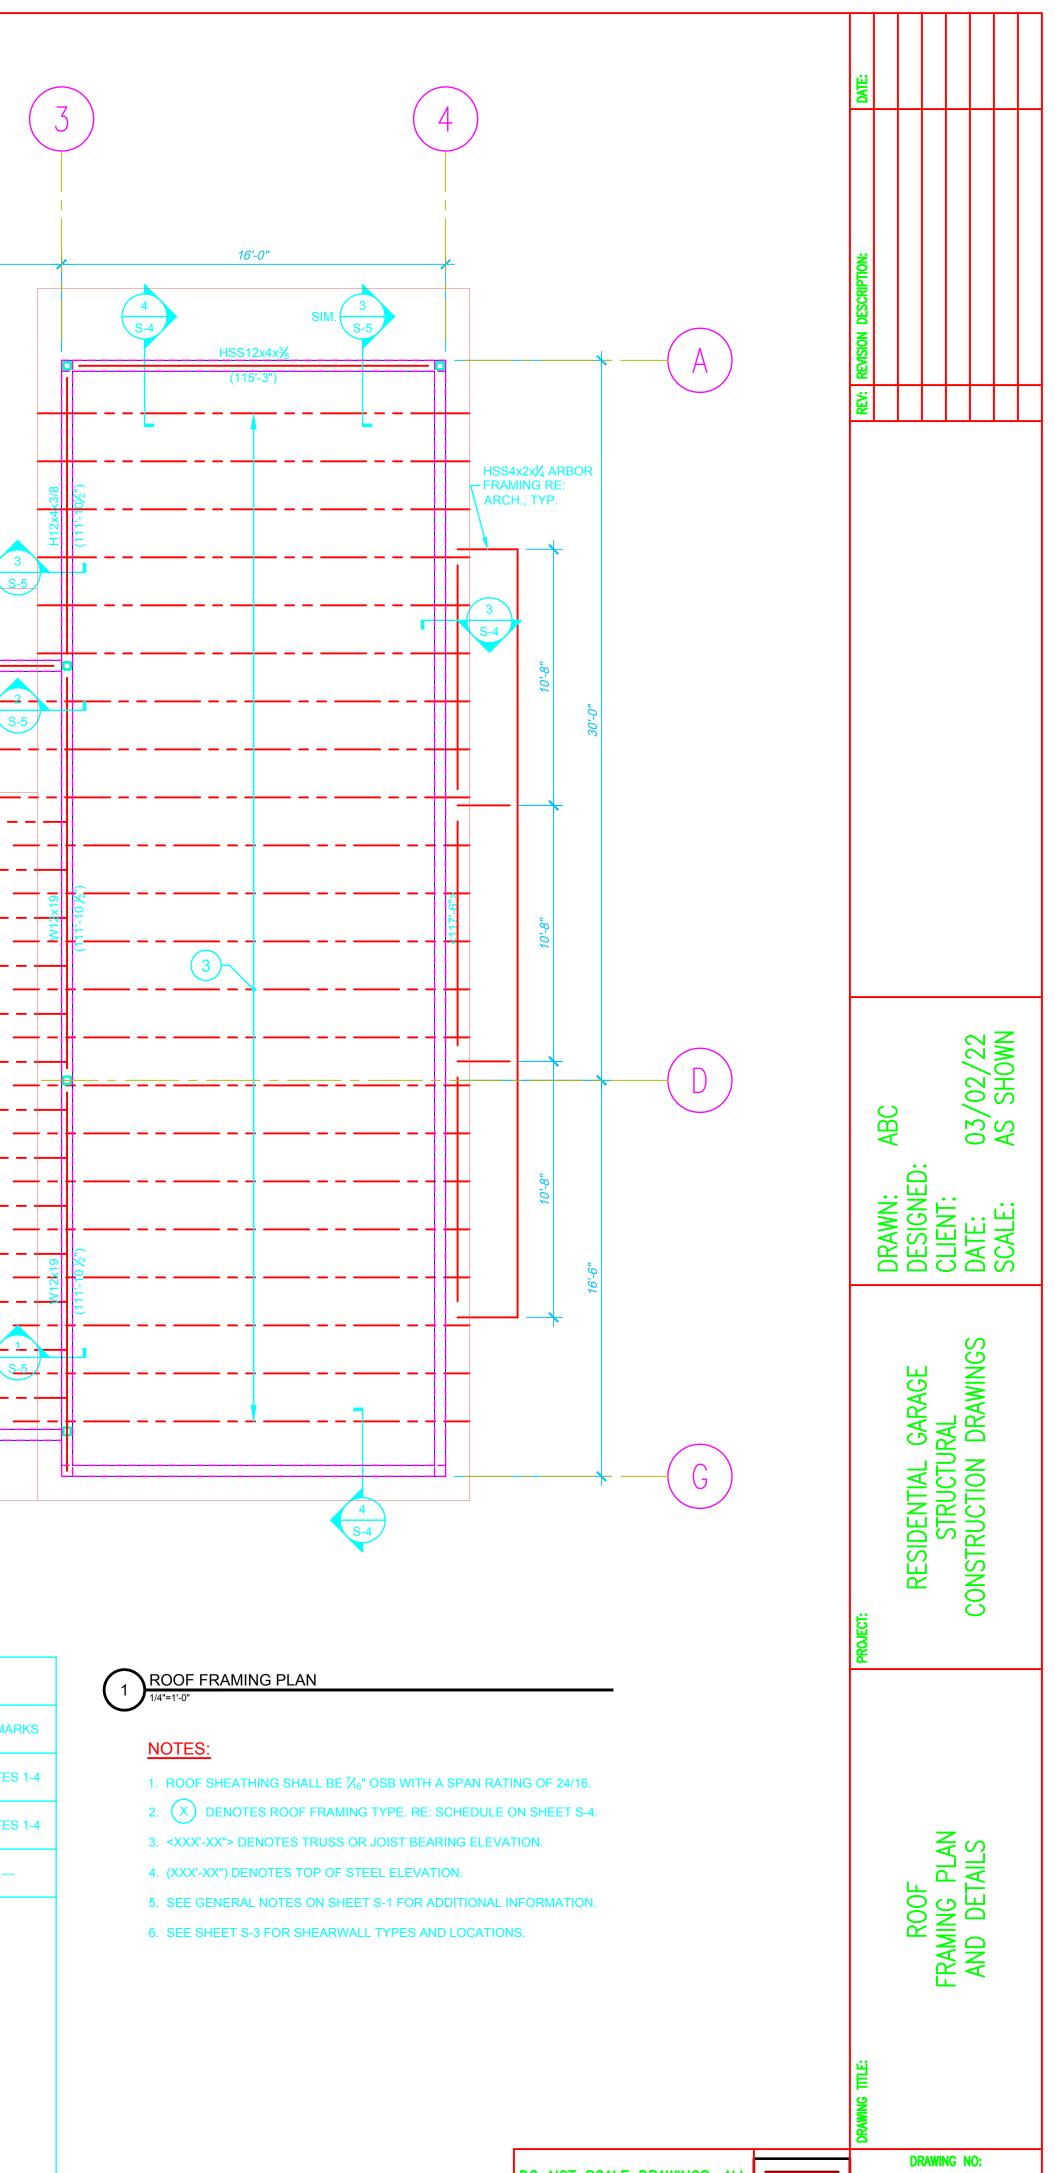

DO NOT SCALE DRAWINGS. AL DIMENSIONS IN FT & IN UNLESS NOTED OTHERWISE.

ABC

S103

OF